Tamas

Hydronic Systems Inc.

Wiring Diagrams

Field Wiring for T-BO-ID-1121

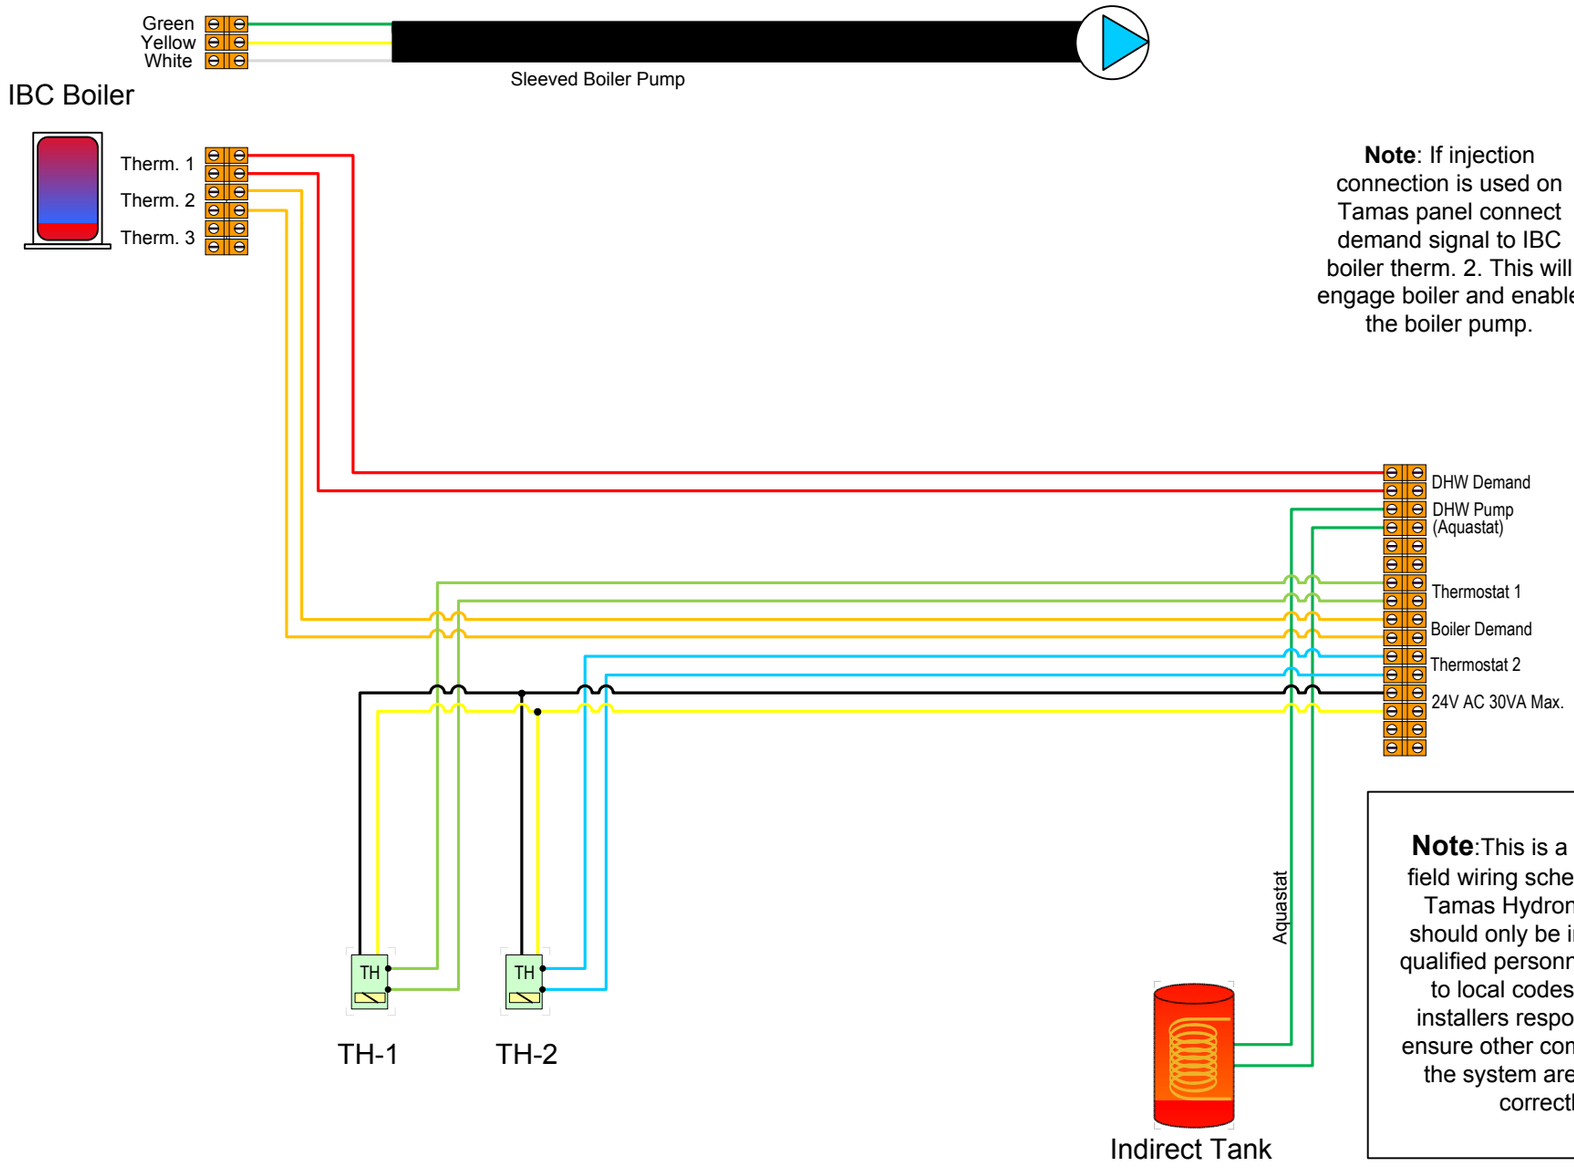

Note: If injection connection is used on Tamas panel connect demand signal to IBC boiler therm. 2. This will engage boiler and enable the boiler pump.

Note:This is a suggested field wiring schematic only. Tamas Hydronic panels should only be installed by qualified personnel adhering to local codes. It is the installers responsibility to ensure other components in the system are installed correctly.