Field Wiring for T-BO-VD-1140 See reverse for Thermostat Wiring Options Canada Notes: This is not an engineered drawing and does not **DHW Demand** necessarily include OW DHW pump OR (Aquastat) all the components Vitodens for an entire system. It is intended as a 100 representative Thermostat 1 Boiler sample of how the RT 🚆 control may be wired ⊖w ⊖R Thermostat 2 for a sample DHW 🤮 application. It is the responsibility of the installer to seek O_R Thermostat 3 professional advice and/or install the the system to meet all W Thermostat 4 necessary codes for the jurisdiction of the Boiler demand actual installation. 24V AC 30VA Max. Connect to Vitodens 100 120VAC Boiler Title TH TH pump output Aquastat T-BO-VD-1140 1 High Temp TH-1 TH-2 TH-4 TH-3 4 Low Temp Zones Thermostat 1-4 Low Temp Zones Date: Boiler Pump Drawn: Indirect Tank

Thermostat Wiring Options


2 Wire Thermostat

THERMOSTAT

Thermostat


e e c 24 V AC 30VA Max

3 Wire Thermostat



See reverse for Thermostat Wiring Options

4 Wire Thermostat

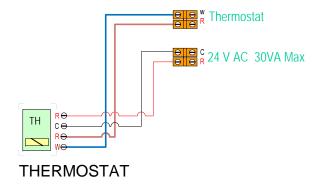



Notes:

This is not an engineered drawing and does not necessarily include all the components for an entire system. It is intended as a representative sample of how the control may be wired for a sample application. It is the responsibility of the installer to seek professional advice and/or install the the system to meet all necessary codes for the jurisdiction of the actual installation.

Title

Date:

Drawn:

