Field Wiring for T-BO-VO-1021 Canada Notes: See reverse for Thermostat Wiring Options This is not an engineered drawing and does not necessarily include all the components for an entire system. It is intended as a representative Vitodens sample of how the control may be wired 100 for a sample W Thermostat 1 Boiler application. It is the responsibility of the W Thermostat 2 installer to seek Heat Demand (Boiler Pump) professional advice and/or install the the Boiler demand system to meet all DHW P necessary codes for the jurisdiction of the actual installation. C 24V AC 30VA Max. Title Connect to Vitodens 100 120VAC Boiler pump output Auxiliary heating unit. Close this contact to engage the boiler pump TH-1 TH-2 and the boiler demand contact. (Optional connection) Date: Drawn: **Boiler Pump**

Thermostat Wiring Options


2 Wire Thermostat

THERMOSTAT

Thermostat


e e c 24 V AC 30VA Max

3 Wire Thermostat



See reverse for Thermostat Wiring Options

4 Wire Thermostat

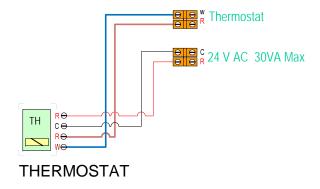



Notes:

This is not an engineered drawing and does not necessarily include all the components for an entire system. It is intended as a representative sample of how the control may be wired for a sample application. It is the responsibility of the installer to seek professional advice and/or install the the system to meet all necessary codes for the jurisdiction of the actual installation.

Title

Date:

Drawn:

